


1 WTC 7th FLOOR MER PLAN


0 16 32
SCALE IN FEET

NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG E-1.
2. REMOVE TRX AND E.O.L. FROM EXIST. BOX LOCATED ABOVE MCC AND INSTALL TRX-06 AND NEW E.O.L. DISCONNECTION AND RECONNECTION OF PURGE SWITCH CIRCUITRY SHALL BE DONE BY THE CONTRACTOR IN THE PRESENCE OF THE ENGINEER.
3. FOR 7th FLOOR MER RISER DIAGRAM, SEE DWG E-6.
4. FOR 7th FLOOR MER REMOVAL PLAN, SEE DWG E-8.

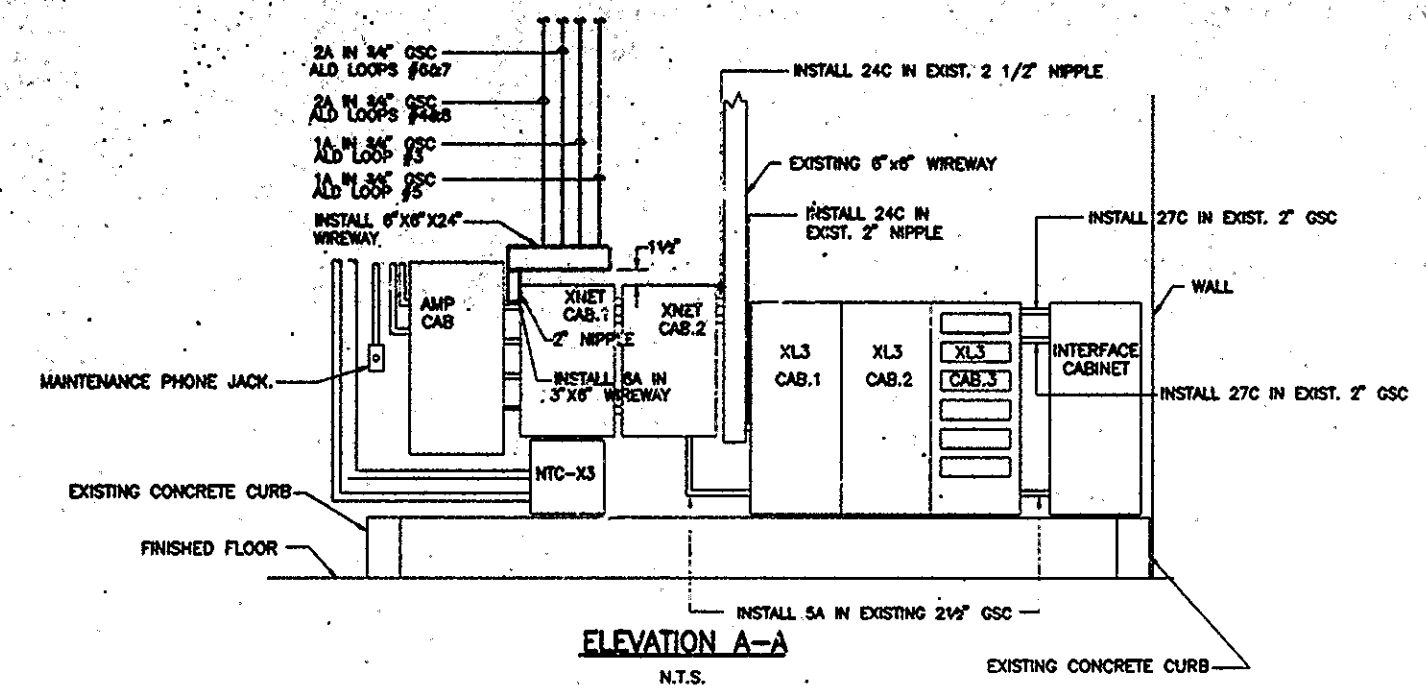

ELEVATION A-A
N.T.S.

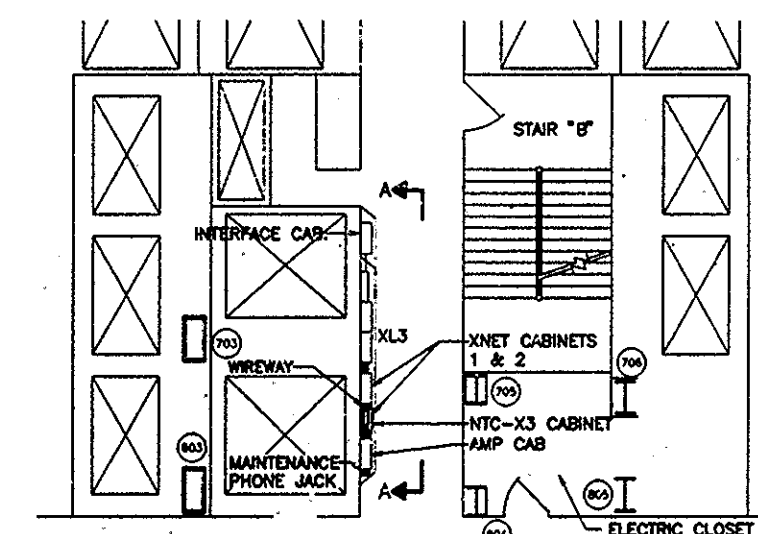


DETAIL "A"
N.T.S.

0 4 8 12 16
SCALE IN FEET

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT COPY OF ONE OF THE CONTRACT DRAWINGS CONSTITUTING A PART OF CONTRACT NO. WTC-881082 IN THE FORM IN WHICH SAID DRAWINGS EXISTED AT THE TIME THE SAID CONTRACT WAS EXECUTED BY THE PARTIES.

DATE 2/1/00 [Signature]
CONTRACT ENGINEER/ARCH.

DATE 2/3/00 [Signature]
ENGINEERING PROGRAM MGR.



KEY PLAN

Sheet 0 of 88

THE PORT AUTHORITY OF NY & NJ

ENGINEERING PROGRAM MANAGER
WORLD TRADE CENTER
[Signature]
CHIEF ELECTRICAL ENGINEER

No.	Date	Revision	Approved
Engineering Department			
Design Division			
The World Trade Center			
Title			
FIRE ALARM SYSTEM			
PHASE III			
XL3 CONVERSION			
ELECTRICAL			
1 WTC			
7th FLOOR MER PLAN			
This drawing subject to conditions in contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.			
Designed by	ROYZMAN FELDSTEIN	Drawn by	ROYZMAN
Checked by	A.S.		
Date	8-20-99	Scale	AS NOTED
Contract Number	WTC-881082	Drawing Number	E-7